

4



3

2

1

CLOPAY MODELS: 73, 75 HOLMES MODEL 42 (25 GA. STEEL SKIN)
 CLOPAY MODELS: 84A, 94 HOLMES MODEL 48 (24 GA. STEEL SKIN)
 CLOPAY MODEL 1500 (25 GA. STEEL SKIN WITH 1-5/16" THICK POLYSTYRENE FOAM INSULATION)



REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
00	-	10/28/03	ER1022R02	SH	ORIGINAL ISSUE

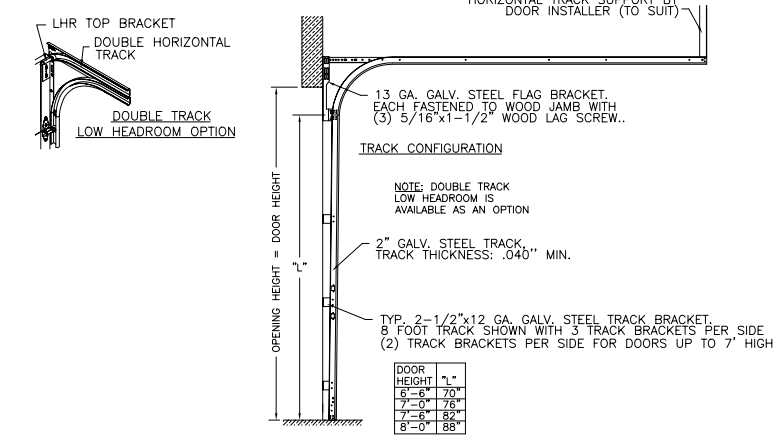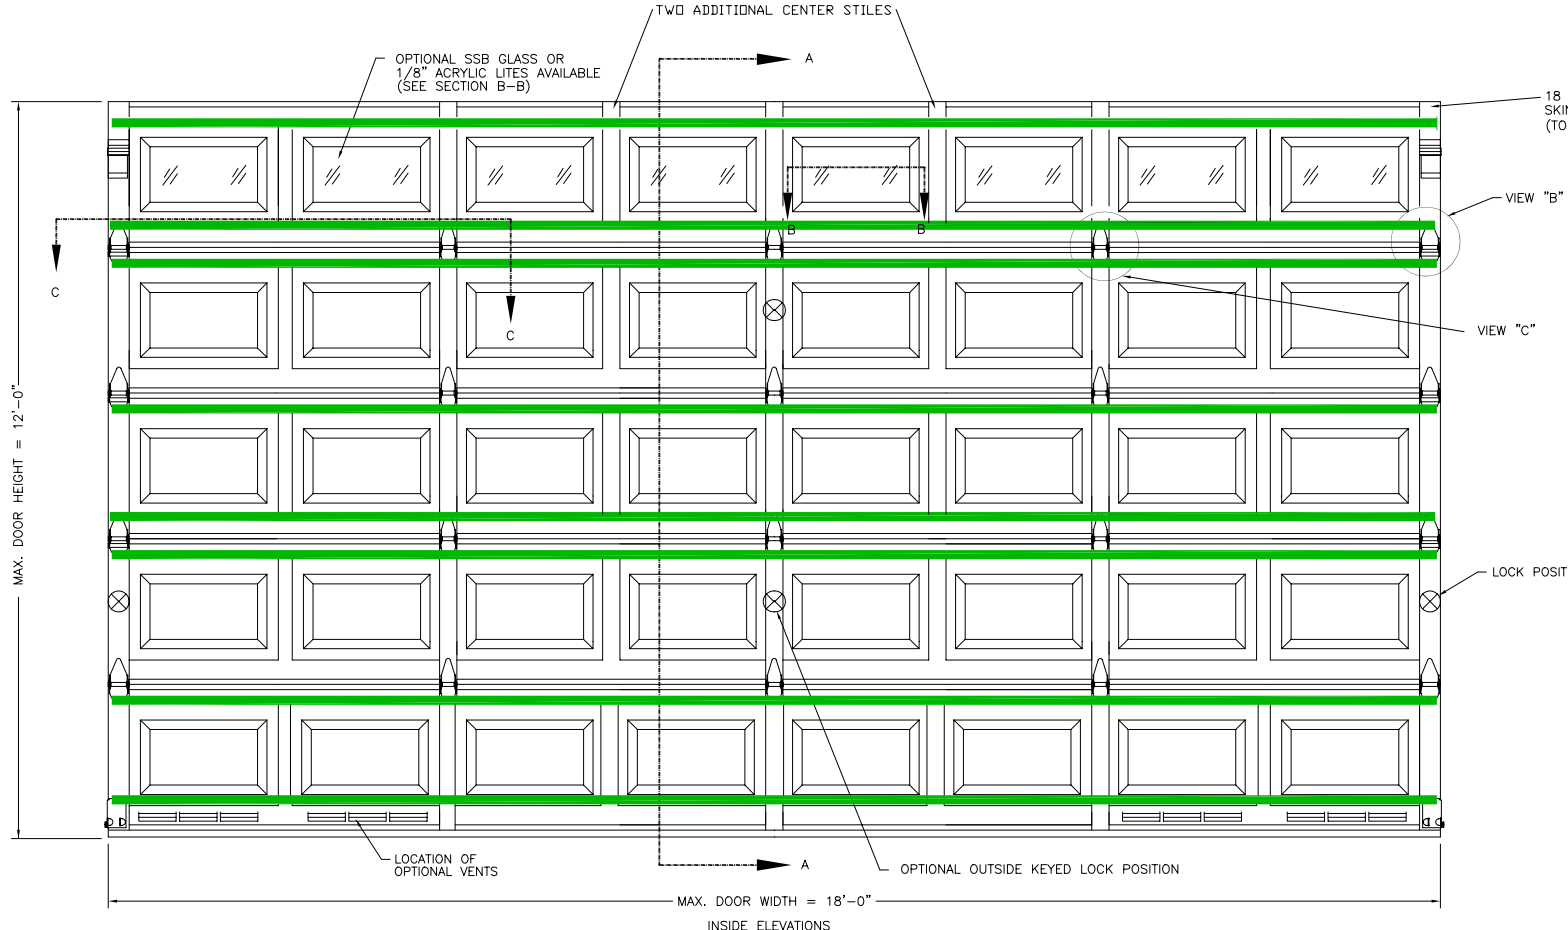

VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS):
 OPTION 1: 3/8" x 3" (1-1/2" EMBED) LAG SCREWS ON 24" CENTERS, 1-1/8" O.D. MIN. WASHER REQUIRED, LAG SCREWS MAY BE COUNTERSUNK (NOT REQUIRED) TO PROVIDE FLUSH MOUNTING SURFACE.
 OPTION 2: 16D x 3-1/2" (2" EMBED) COMMON WIRE NAILS ON 7" CENTERS. (HORIZONTAL JAMBS DO NOT TRANSFER LOAD.)

THIS DOOR MEETS OR EXCEEDS THE DESIGN LOADS FOR THE WIND SPEEDS LISTED BELOW ACCORDING TO THE 2000 INTERNATIONAL BUILDING/RESID. CODE FOR THE FOLLOWING CONDITIONS: 1) ENCLOSED BUILDING, 2) DOOR HAS 2' OF WIDTH IN BUILDING'S END ZONE, 3) IMPORTANCE FACTOR OF 1.0, 4) ANY ROOF SLOPE, AND 5) 50% SAFETY FACTOR.



WIND SPEED (MPH)	≤ 90
EXPOSURE LEVEL	B
MEAN ROOF HEIGHT	30'

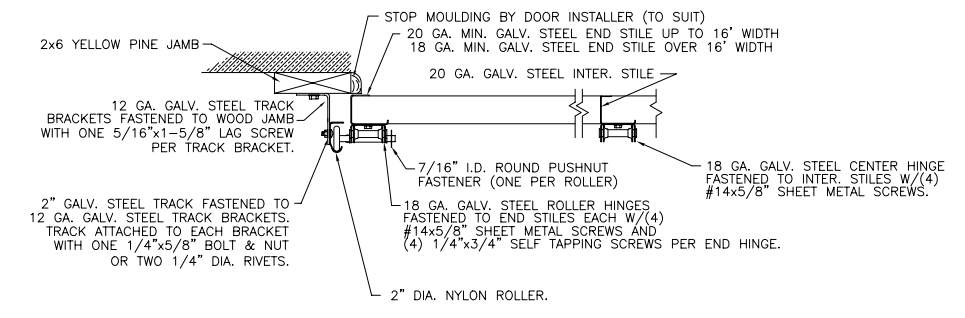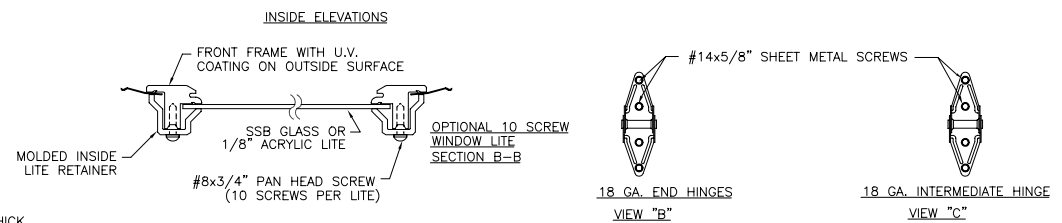

PREPARATION OF JAMBS BY OTHERS, JAMB CONFIGURATION SECTION C-C

DESIGN ENGINEER: MARK WESTERFIELD, P.E. FLORIDA P.E. #48495

DESIGN LOADS: +12.5 PSF & -14.0 PSF
 TEST LOADS: +19.0 PSF & -21.0 PSF

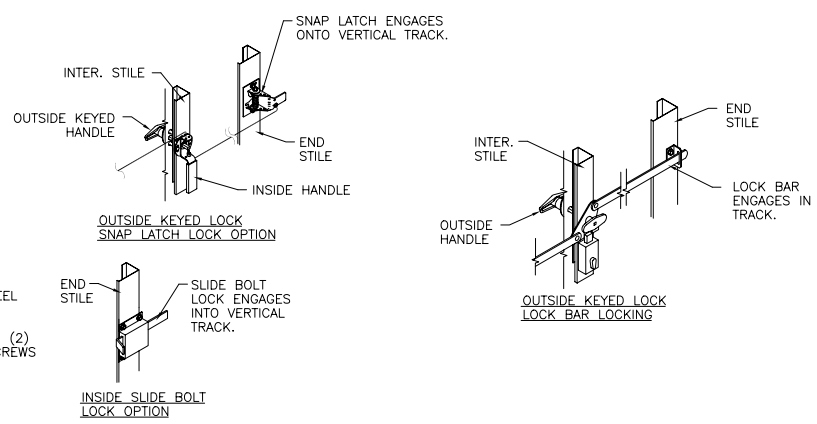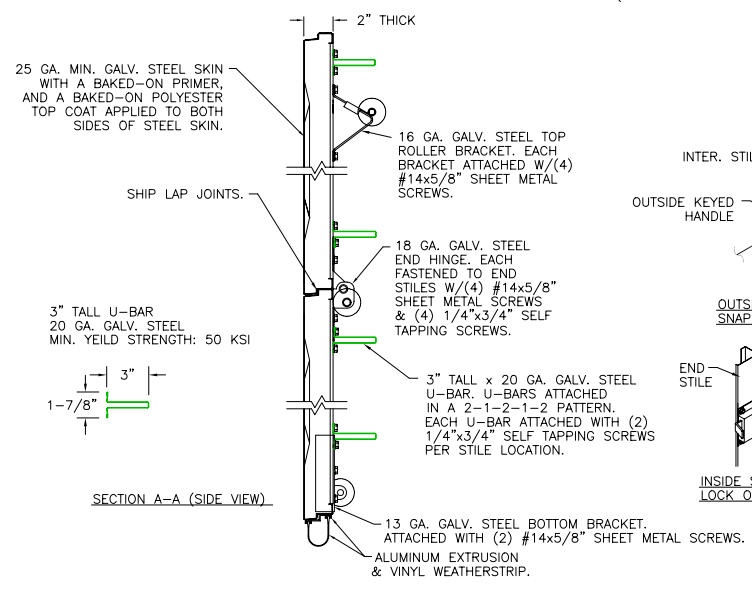

NOTE: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

PART NO.: N/A

NOTICE: Confidential/Proprietary information of CLOPAY BUILDING PRODUCTS CO. is contained herein and may not be disclosed, used, duplicated, made available, or distributed without its prior consent. Failure to observe this notice may result in liability for any damages and losses resulting therefrom.

Third Angle Projection

Unless Stated Otherwise TOLERANCES are

.0	± .031
.00	± .015
.000	± .005
.0000	± .001
Degrees	± 1/2°

Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

Glopay Building Products Company

8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

DESCRIPTION: M/N 73/75/84A/94 18'W +12.5/-14.0 PSF DES.

DRAWN BY: SEJ	DATE: 7/28/03	SCALE: NTS	DWG. SIZE B
CHECKED BY: SH	DATE: 09/05/03	SHEET 1 OF 1	

DWG. NO.: 102933 REV. NO. 00

4

3

2

1